



2018-10-29

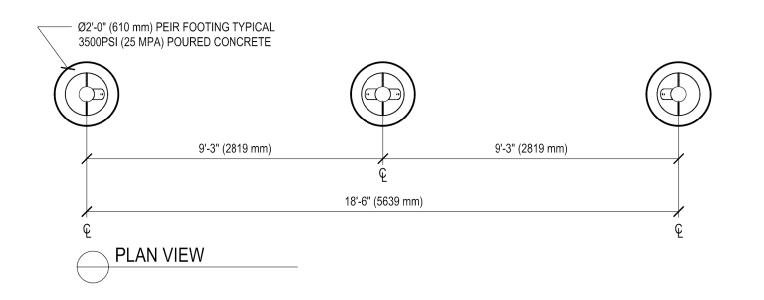

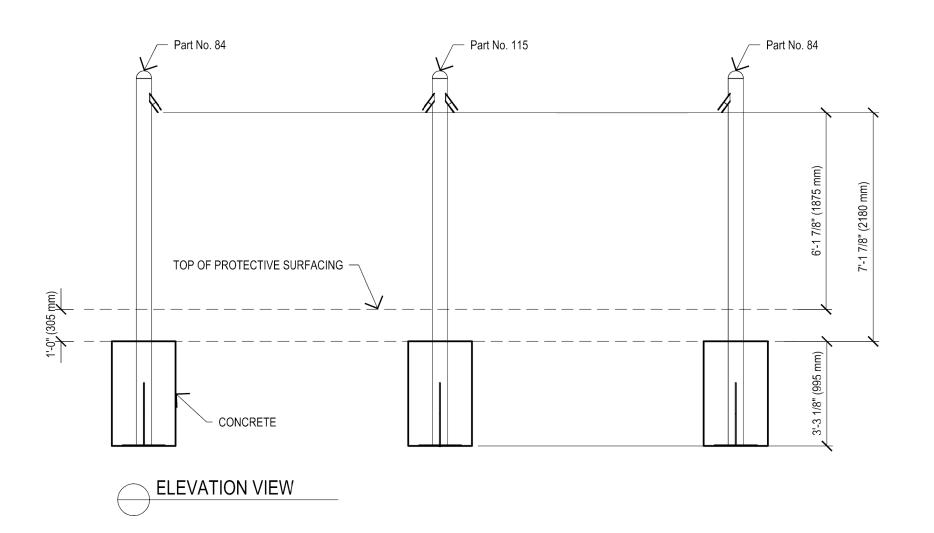

DOCUMENT NO:		200-000-167	
REV. NO.	DESCRIPTION/REFERENCE		DATE
0	Revised for ECO# 1711-09 -DOC No. AddedP/N Reference added -Height Reference Added		2018-03-08

General Notes:

- 1. THE FOUNDATION IN THE DRAWING TO BE USED AS A MININUM GUIDELINE.
- 2. THE CONCRETE SHALL BE GRADE C25 (CHARACTERISTIC STRENGTH OF 3500 PSI AT 28 DAYS) MINIMUM.
- 3. THE FOUNDATION SHALL BE PLACED ON FIRM, UNDISTURBED SOIL SURFACE. WHEREVER EXCAVATION OCCURS BELOW THE DESIGNED FOUNDATION LEVEL, WELL COMPACTED BACK FILL OR LEAN CONCRETE SHALL BE USED FOR LEVELING.
- 4. BACKFILLING FOR FOUNDATION SHALL BE PLACED EVENLY IN LAYERS OF 6" (150mm) THICKNESS AND SHALL BE WELL COMPACTED.
- 5. THE FOUNDATION DESIGN IS SUITABLE FOR SOIL WITH A BEARING CAPACITY OF 1600 PSF (80 KPA) AND ABOVE.
- 6. THE FOUNDATION DESIGN IS SUITABLE FOR SOIL WITH FROST LINE OF 4' (1200 MM) OR LESS.

CLIENT: STOCK

PROJECT NAME: STOCK

PROJECT ADDRESS:

CHECK LOCAL REGULATIONS

DRAWING TITLE: BIGGO SPIA DUO
FOUNDATIONLAYOUT DRAWING

PRODUCT NO:

DX -3275

	NAME	DATE
DESIGNER:		
DRAWN BY:	William McNair	2018-03-08
CHECKED BY:		
REVIEWED BY:		
APPROVED BY:		
SHEET SIZE:	PAGE NO:	SCALE:
PA3	1 of 1	NTS



Toll free: 800-790-0034 Local: 613-446-0030 Fax: 613-446-0034